



NÁVOD POUŽITÍ JEDNOTLIVĚ BALENÝCH ZAKRYTOVANÝCH TERMOSTATŮ TS9510-TS9520

TS9510: zakrytovaný termostat na jímku s ovládáním knoflíkem, balený jednotlivě v krabici (obr. 1)
TS9520: zakrytovaný kapilárový termostat s ovládáním knoflíkem, balený jednotlivě v krabici (obr. 3)

PODMÍNKY POUŽITÍ

Termostaty se musejí namontovat a používat v souladu s pokyny uvedenými níže, aby mohly správně a bezpečně pracovat. Je nutné je ochránit před vodou a prachem. Tyto termostaty jsou testovány na bezpečnost podle evropských norem a jsou klasifikovány takto:

- podle provedení: jako automatické regulační zařízení pro nezávislou montáž
- podle automatického provozu: jako přístroj s typem řízení 1.B

INSTALACE

Instalace typu TS9510 se provádí na měděnou jímku nebo děrovanou jímku (pro vzduchotechnické potrubí). Postup je následující:
- na JIMKU (obr. 4): namontujte jímku do příslušného nátrubku v zařízení, zasuňte do ní čidlo termostatu a přichyťte ho šroubkem dle obr. 2.

- do děrované jímky (obr. 5): umístěte přírubu trubky do příslušného otvoru v zařízení, do trubky zasuňte čidlo termostatu a přichyťte ho šroubkem dle obr. 2.

Instalace typu TS9520 se provádí pomocí dvou otvorů v krabici termostatu (obr. 3). Postup je následující:

- sejměte knoflík, odšroubujte 2 šroubky z víka, umístěte termostat na místo, přišroubujte ho dvěma šroubky skrz otvory, pak proveďte elektrické zapojení (dle pokynů níže), pak vraťte na místo víko a nakonec knoflík.

ELECTRICKÉ ZAPOJENÍ

Před zahájením prací na elektrickém připojení se ujistěte, že kabely nejsou pod napětím. Připojení se provádí pomocí svorkovnice. Maximální průřez kabelu je 2,5 mm².

Doporučujeme použít elektrické kabely vhodné pro teplotu prostředí, ve které se zařízení nachází.

Schéma zapojení se nachází na štítku uvnitř termostatu. Elektrické připojení musí provést osoba odborně způsobilá.

Sejměte knoflík a po odšroubování 2 šroubů i víko, protáhněte kabely od systému průchodkou a připojte ke svorkovnici. Vraťte na místo víko, zašroubujte šroubky a nasadte knoflík.

ZAPOJENÍ C-1: rozepiná kontakty, když teplota stoupá.

ZAPOJENÍ C-2: spiná kontakty, když teplota stoupá.

TEPLOTNÍ, ELEKTRICKÉ A MECHANICKÉ VLASTNOSTI

Teplotní rozsahy: -35 ÷ +35 °C, 0 ÷ +60 °C, 0 ÷ +90 °C, 0 ÷ +300 °C

Jmenovité zatížení kontaktů: C-1 16 (3)A / 250V~ (rozepinání)
C-2 6 (1)A / 250V~ (spinání)

Max. okolní teplota: T90

Teplotní difference: 2 ÷ 5K (závisí na modelu termostatu)


Stupeň krytí: IP 40

Trída krytí:

Teplota skladování: 0 ÷ 60 °C

CE POZNÁMKY

Typ rozeznání: mikro-rozeznání
Stupeň znečištění mikroprostředí: 2
Skupina izolačního materiálu: IIIa
Trída přepětí: II 1500 V
Trvání elektrického namáhání: dlouhodobé
Počet cyklů: 100 000

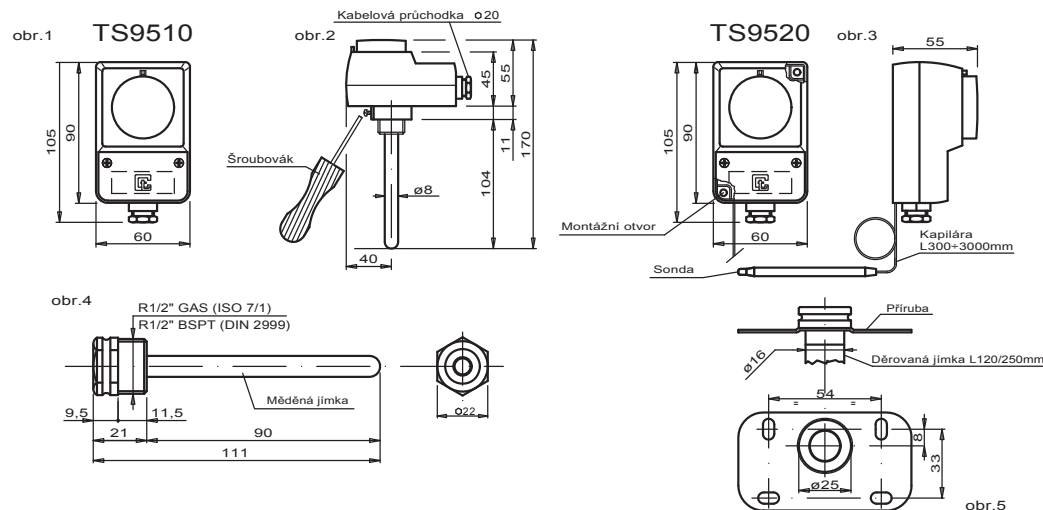

Výrobce:



Termoregolatori Campini Corel S.p.A.
22066 Mariano Comense - Como - Italy
Via Don Guanella, 1

Regulus spol. s r.o.
Do koutů 1897/3, 143 00 Praha 4
Tel.: 241 764 506 Fax: 241 763 971
e-mail: obchod@regulus.cz, www.regulus.cz



Distributor:



NÁVOD POUŽITÍ JEDNOTLIVĚ BALENÝCH ZAKRYTOVANÝCH TERMOSTATŮ TS9510-TS9520

TS9510: zakrytovaný termostat na jímku s ovládáním knoflíkem, balený jednotlivě v krabici (obr. 1)
TS9520: zakrytovaný kapilárový termostat s ovládáním knoflíkem, balený jednotlivě v krabici (obr. 3)

PODMÍNKY POUŽITÍ

Termostaty se musejí namontovat a používat v souladu s pokyny uvedenými níže, aby mohly správně a bezpečně pracovat. Je nutné je ochránit před vodou a prachem. Tyto termostaty jsou testovány na bezpečnost podle evropských norem a jsou klasifikovány takto:

- podle provedení: jako automatické regulační zařízení pro nezávislou montáž
- podle automatického provozu: jako přístroj s typem řízení 1.B

INSTALACE

Instalace typu TS9510 se provádí na měděnou jímku nebo děrovanou jímku (pro vzduchotechnické potrubí). Postup je následující:
- na JIMKU (obr. 4): namontujte jímku do příslušného nátrubku v zařízení, zasuňte do ní čidlo termostatu a přichyťte ho šroubkem dle obr. 2.

- do děrované jímky (obr. 5): umístěte přírubu trubky do příslušného otvoru v zařízení, do trubky zasuňte čidlo termostatu a přichyťte ho šroubkem dle obr. 2.

Instalace typu TS9520 se provádí pomocí dvou otvorů v krabici termostatu (obr. 3). Postup je následující:

- sejměte knoflík, odšroubujte 2 šroubky z víka, umístěte termostat na místo, přišroubujte ho dvěma šroubky skrz otvory, pak proveďte elektrické zapojení (dle pokynů níže), pak vraťte na místo víko a nakonec knoflík.

ELECTRICKÉ ZAPOJENÍ

Před zahájením prací na elektrickém připojení se ujistěte, že kabely nejsou pod napětím. Připojení se provádí pomocí svorkovnice. Maximální průřez kabelu je 2,5 mm².

Doporučujeme použít elektrické kabely vhodné pro teplotu prostředí, ve které se zařízení nachází.

Schéma zapojení se nachází na štítku uvnitř termostatu. Elektrické připojení musí provést osoba odborně způsobilá.

Sejměte knoflík a po odšroubování 2 šroubů i víko, protáhněte kabely od systému průchodkou a připojte ke svorkovnici. Vraťte na místo víko, zašroubujte šroubky a nasadte knoflík.

ZAPOJENÍ C-1: rozepiná kontakty, když teplota stoupá.

ZAPOJENÍ C-2: spiná kontakty, když teplota stoupá.

TEPLOTNÍ, ELEKTRICKÉ A MECHANICKÉ VLASTNOSTI

Teplotní rozsahy: -35 ÷ +35 °C, 0 ÷ +60 °C, 0 ÷ +90 °C, 0 ÷ +300 °C

Jmenovité zatížení kontaktů: C-1 16 (3)A / 250V~ (rozepinání)
C-2 6 (1)A / 250V~ (spinání)

Max. okolní teplota: T90

Teplotní difference: 2 ÷ 5K (závisí na modelu termostatu)


Stupeň krytí: IP 40

Trída krytí:

Teplota skladování: 0 ÷ 60 °C

CE POZNÁMKY

Typ rozeznání: mikro-rozeznání
Stupeň znečištění mikroprostředí: 2
Skupina izolačního materiálu: IIIa
Trída přepětí: II 1500 V
Trvání elektrického namáhání: dlouhodobé
Počet cyklů: 100 000

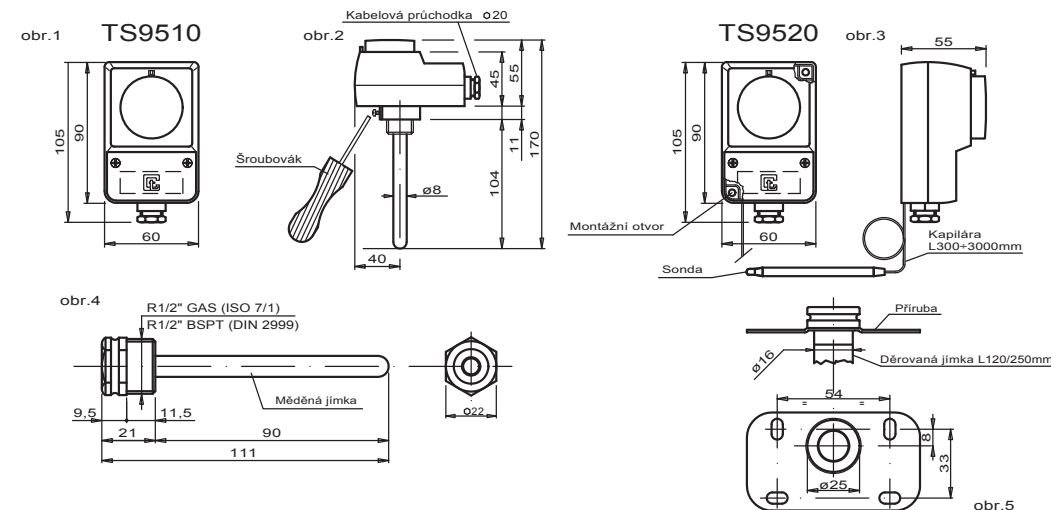

Výrobce:



Termoregolatori Campini Corel S.p.A.
22066 Mariano Comense - Como - Italy
Via Don Guanella, 1

Regulus spol. s r.o.
Do koutů 1897/3, 143 00 Praha 4
Tel.: 241 764 506 Fax: 241 763 971
e-mail: obchod@regulus.cz, www.regulus.cz

Distributor:



USER INSTRUCTIONS TS9510-TS9520 SINGLE BOXED THERMOSTATS

TS9510: immersion boxed thermostat with external temperature adjustment (pic.1)
TS9520: capillary boxed thermostat with external temperature adjustment (pic.3)

CONDITIONS OF USE

For the correct working and for safety reasons the thermostat is to be installed and used according to the instructions herebelow provided. The thermostat must be protected from water and dust. The boxed thermostats have been tested in compliance with the European standards for safety and have been classified as follows:
(1) according to its manufacture: as an automatic control device by independent mounting.
(2) according to its automatic operating feature: as a 1.B operated control type.

INSTALLATION

Installation of TS9510 is made by means of a copper pocket or a ventilated tube. Proceed as follows:
- by means of a COPPER POCKET (pic.4): fix the pocket in the seat on the appliance and screw it through the threaded connection, put the thermostat probe inside the pocket and fix the pocket to the thermostat base using the fixing screw (pic.2)
- by means of a VENTILATED TUBE (pic.5): fix the flange of the ventilated tube in the seat on the appliance, put the thermostat probe inside the ventilated tube and fix the tube to the thermostat base using the fixing screw (pic.2).
Installation of TS9520 is made using the 2 holes which are in the base of the thermostat (pic.3). Proceed as follows:
- remove the knob, unscrew the 2 screws on the cover, place the thermostat, screw the 2 fixing screws on the holes, proceed with the electrical connection (as shown herebelow), replace the cover first and then the knob.

ELECTRICAL CONNECTION


Before proceeding with the electrical connection, make sure that there is no voltage in the cables. The electrical connection is ensured by means of screw terminals. Maximum diameter of the cross-section=2,5mm.²
The wiring diagram is shown on the label inside the product. The electrical connection must be executed by professional personnel according to standards and to laws in force.
Remove the knob and the cover by unscrewing the 2 screws, put the wires of the system through the cable-gland and make the electrical connections to the cable-box, replace the cover, fix the screws and replace the knob.

THERMAL, ELECTRICAL AND MECHANICAL FEATURES

Temperature ranges: -35 + +35 °C, 0 + +90 °C, 0 + +300 °C
Nominal load: C-1 16 (3)A / 250V ~ (opening contact)
C-2 6 (1)A / 250V ~ (closing contact)
Max. ambient temperature: T90
Differential: 2 + 5K (depending on the model of thermostat)
Protection degree: IP 40
Insulation class: □
Storage temperature: 0 + 60 °C



Number of cycles: 100,000
Duration of electric stress: long period
Overvoltage class: II 1500 V
Group of insulation material: IIIa
Micro-environment pollution degree: 2
Type of disconnection: micro-disconnection

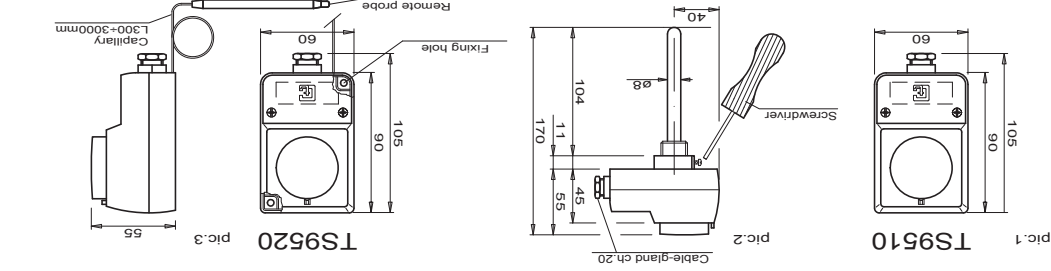


Distributor:



Regulus spol. s r.o., Czech Republic
Do koutu 1897/3, 143 00 Praha 4
Tel.: ++420 241 765 191 Fax: ++420 241 763 976
e-mail: sales@regulus.cz, www.regulus.eu

Producer:

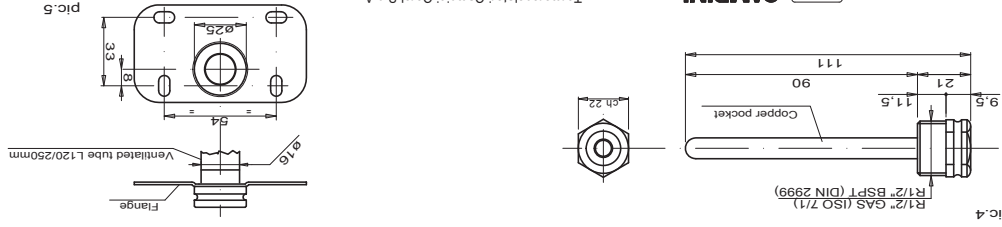

USER INSTRUCTIONS TS9510-TS9520 SINGLE BOXED THERMOSTATS

TS9510: immersion boxed thermostat with external temperature adjustment (pic.1)
TS9520: capillary boxed thermostat with external temperature adjustment (pic.3)

CONDITIONS OF USE

For the correct working and for safety reasons the thermostat is to be installed and used according to the instructions herebelow provided. The thermostat must be protected from water and dust. The boxed thermostats have been tested in compliance with the European standards for safety and have been classified as follows:
(1) according to its manufacture: as an automatic control device by independent mounting.
(2) according to its automatic operating feature: as a 1.B operated control type.

INSTALLATION

Installation of TS9510 is made by means of a copper pocket or a ventilated tube. Proceed as follows:
- by means of a COPPER POCKET (pic.4): fix the pocket in the seat on the appliance and screw it through the threaded connection, put the thermostat probe inside the pocket and fix the pocket to the thermostat base using the fixing screw (pic.2)
- by means of a VENTILATED TUBE (pic.5): fix the flange of the ventilated tube in the seat on the appliance, put the thermostat probe inside the ventilated tube and fix the tube to the thermostat base using the fixing screw (pic.2).
Installation of TS9520 is made using the 2 holes which are in the base of the thermostat (pic.3). Proceed as follows:
- remove the knob, unscrew the 2 screws on the cover, place the thermostat, screw the 2 fixing screws on the holes, proceed with the electrical connection (as shown herebelow), replace the cover first and then the knob.

ELECTRICAL CONNECTION


Before proceeding with the electrical connection, make sure that there is no voltage in the cables. The electrical connection is ensured by means of screw terminals. Maximum diameter of the cross-section=2,5mm.²
The wiring diagram is shown on the label inside the product. The electrical connection must be executed by professional personnel according to standards and to laws in force.
Remove the knob and the cover by unscrewing the 2 screws, put the wires of the system through the cable-gland and make the electrical connections to the cable-box, replace the cover, fix the screws and replace the knob.

THERMAL, ELECTRICAL AND MECHANICAL FEATURES

Temperature ranges: -35 + +35 °C, 0 + +90 °C, 0 + +300 °C
Nominal load: C-1 16 (3)A / 250V ~ (opening contact)
C-2 6 (1)A / 250V ~ (closing contact)
Max. ambient temperature: T90
Differential: 2 + 5K (depending on the model of thermostat)
Protection degree: IP 40
Insulation class: □
Storage temperature: 0 + 60 °C



Number of cycles: 100,000
Duration of electric stress: long period
Overvoltage class: II 1500 V
Group of insulation material: IIIa
Micro-environment pollution degree: 2
Type of disconnection: micro-disconnection

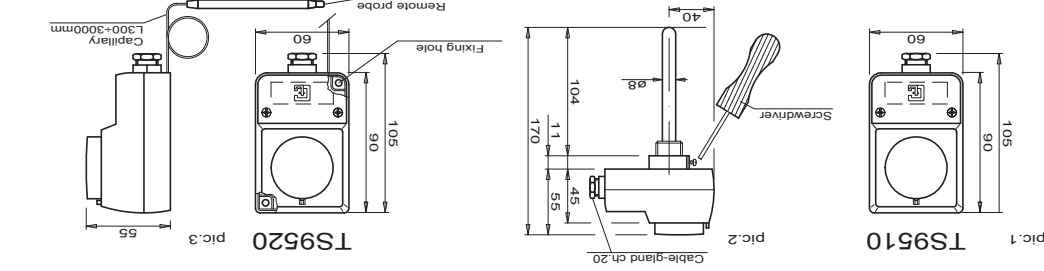

Distributor:



Regulus spol. s r.o., Czech Republic
Do koutu 1897/3, 143 00 Praha 4
Tel.: ++420 241 765 191 Fax: ++420 241 763 976
e-mail: sales@regulus.cz, www.regulus.eu

Producer:

